


DUPLEX STATION CONFIGURATION

NOTES:

1. ALL PIPE & FITTINGS PVC SCHED 80
2. 18"x36" FRC BOX ON DUPLEX STATION
3. PLUG AIR INJECTION PORT WHEN NOT REQUIRED

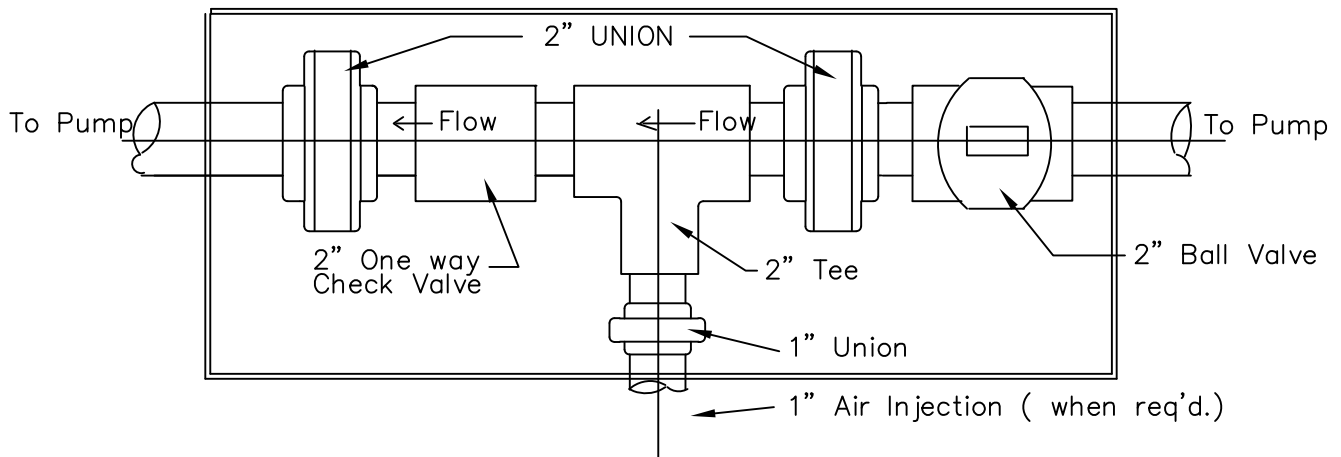

SIMPLEX STATION CONFIGURATION



**ROGUE VALLEY
SEWER SERVICES**

138 WEST VILAS ROAD CENTRAL POINT, OR.

DETAIL AIR INJECTION CONNECTION

Rev.9/07

STANDARD
DRAWING
NO.
7-4
DATE: 9/07